



- NOTES:
1. VENT MUST BE CONNECTED THROUGH KNOCK-OUT LOCATED AT CENTER OF CHAMBER.
 2. VENT MAY ALSO BE CONNECTED AS PERFORMED PIPE THROUGH STONE.
 3. ALL SCHEDULE 40 FITTINGS TO BE SOLVENT CEMENTED.

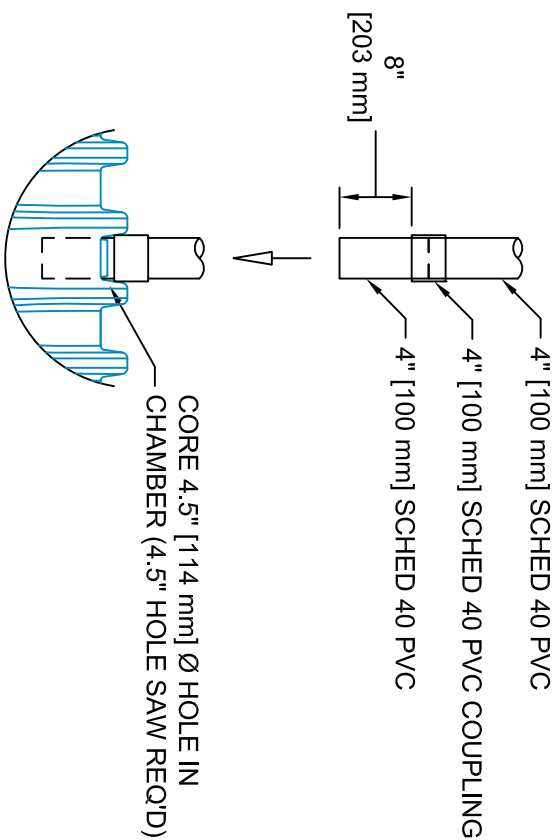

CONNECTION DETAIL
NTS

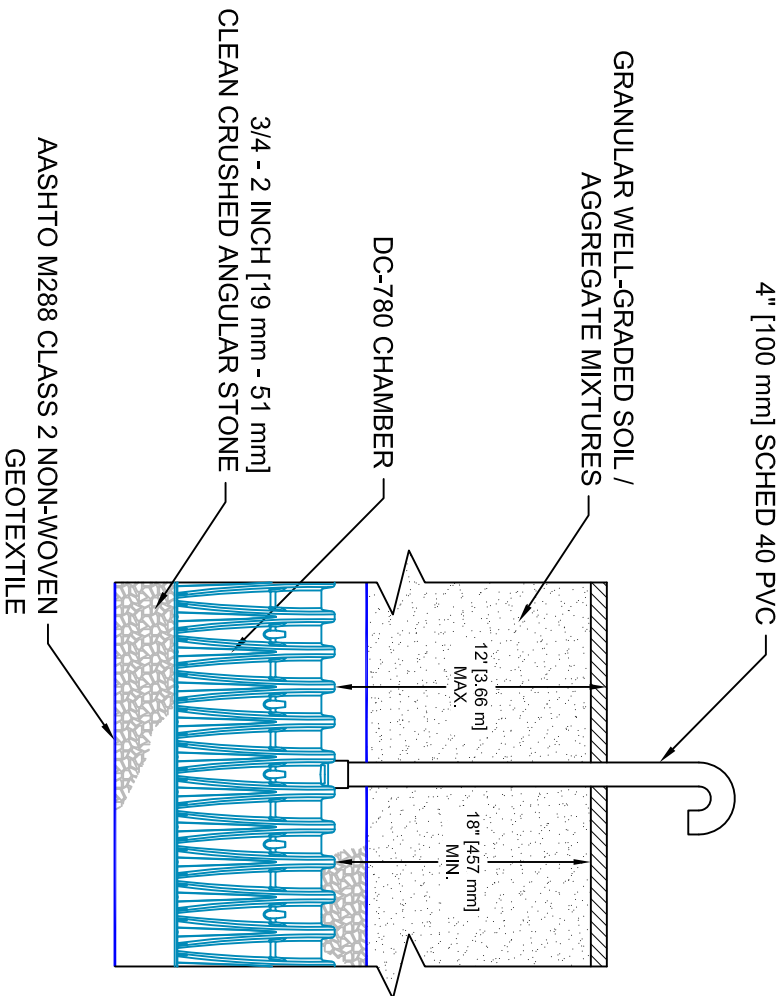

THE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS AND PROJECT REQUIREMENTS.



StormTech
 Division of Retention & Technology
 Subsurfaces Stormwater Management™
 20 BEAVER ROAD, SUITE 104 | WETHERSFIELD, CT 06190
 PHONE: 888-892-2684 | FAX: 866-328-8401
 WWW.STORMTECH.COM

DC-780 VENT DETAIL

SCALE:	NTS
DATE:	3/29/10
DRAWN BY:	KLJ
CHECKED:	